

NOTES:



N1. MINIMUM SPACE BETWEEN WALL AND BACK OF WATER HEATER IS 100mm.

N2. A MINIMUM OF 900mm SHOULD BE LEFT IN FRONT OF THE WATER HEATER FOR ACCESS, SERVICING AND WATER HEATER REMOVAL.

INLET OUTLET CONNECTIONS:-
 RP 1 1/4 / 32

T&PR VALVE CONNECTIONS:-
 RP 3/4 / 20

T&PR VALVE SETTING:-
 1000 kPa

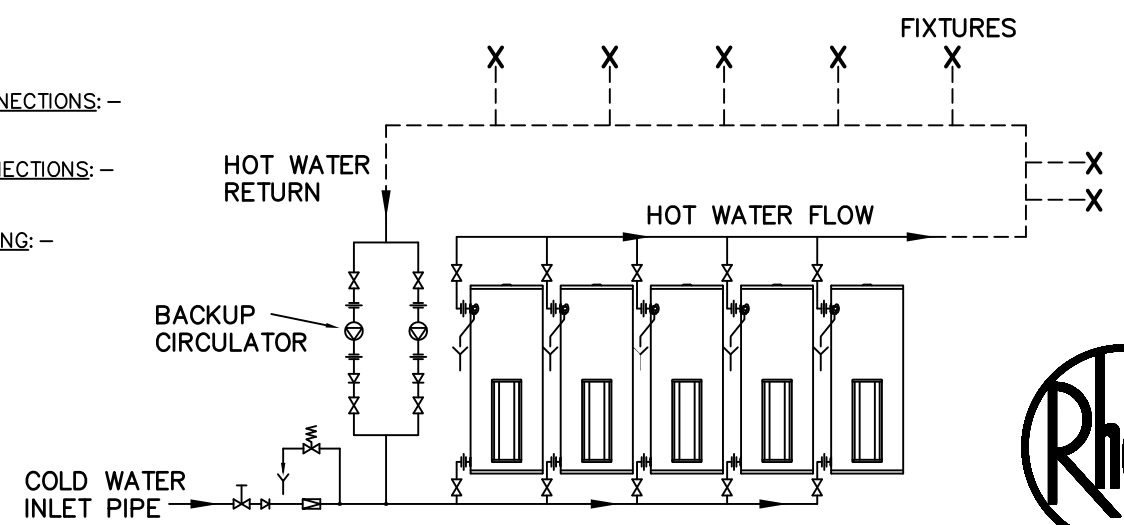

RHEEM WATER HEATERS HEAVY DUTY ELECTRIC 5 x 616315