



- LEGEND**
- STOP COCK
 - NON RETURN VALVE
 - PRESSURE LIMITING VALVE (IF REQUIRED)
 - COLD WATER RELIEF VALVE
 - GATE VALVE
 - CIRCULATOR
 - FIXTURES
 - DIRECTION OF FLOW
 - UNION
 - TUNDISH

INLET OUTLET CONNECTIONS:-
 RP 1 1/4 / 32

T&PR VALVE CONNECTIONS:-
 RP 3/4 / 20

T&PR VALVE SETTING:-
 1000 kPa

- NOTES:**
- N1. MINIMUM SPACE BETWEEN WALL AND BACK OF WATER HEATER IS 100mm.
 - N2. A MINIMUM OF 900mm SHOULD BE LEFT IN FRONT OF THE WATER HEATER FOR ACCESS, SERVICING AND WATER HEATER REMOVAL.

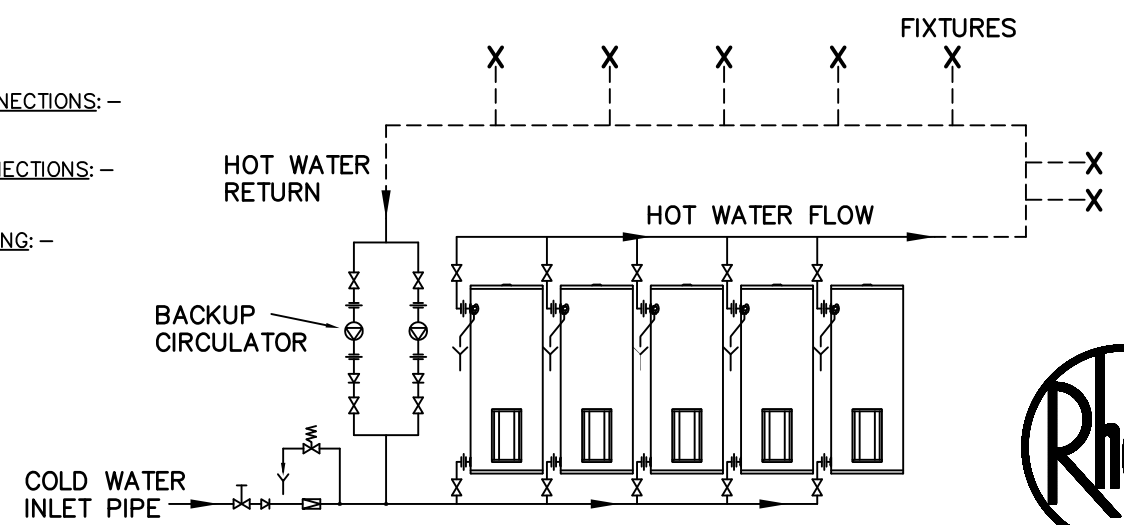

RHEEM WATER HEATERS HEAVY DUTY ELECTRIC 5 x 613315